



INSTALL CAPPED STUBS TO CLEAR DRAIN ROCK IF STORM MAIN EXTENSIONS ARE REQUIRED IN FUTURE

LOCATION TO CONFORM WITH FUTURE STORM SEWER ALIGNMENT

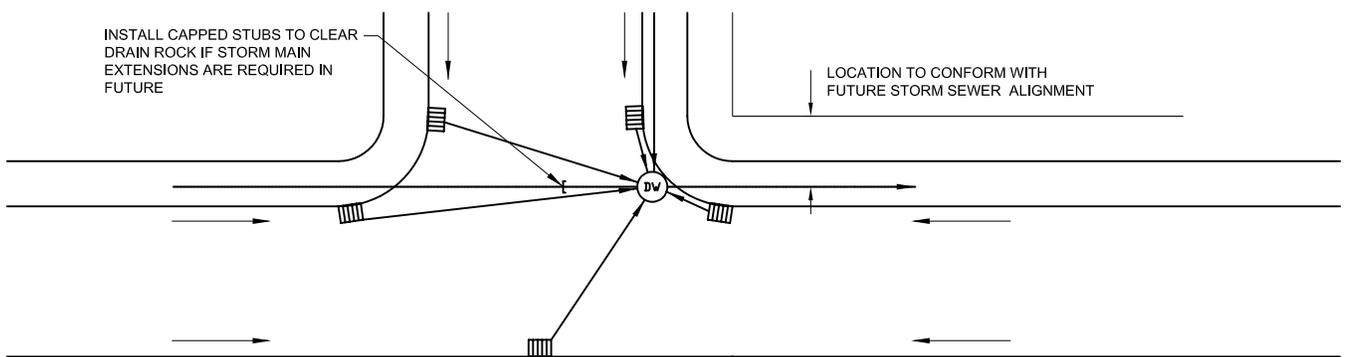

TYPICAL INSTALLATION

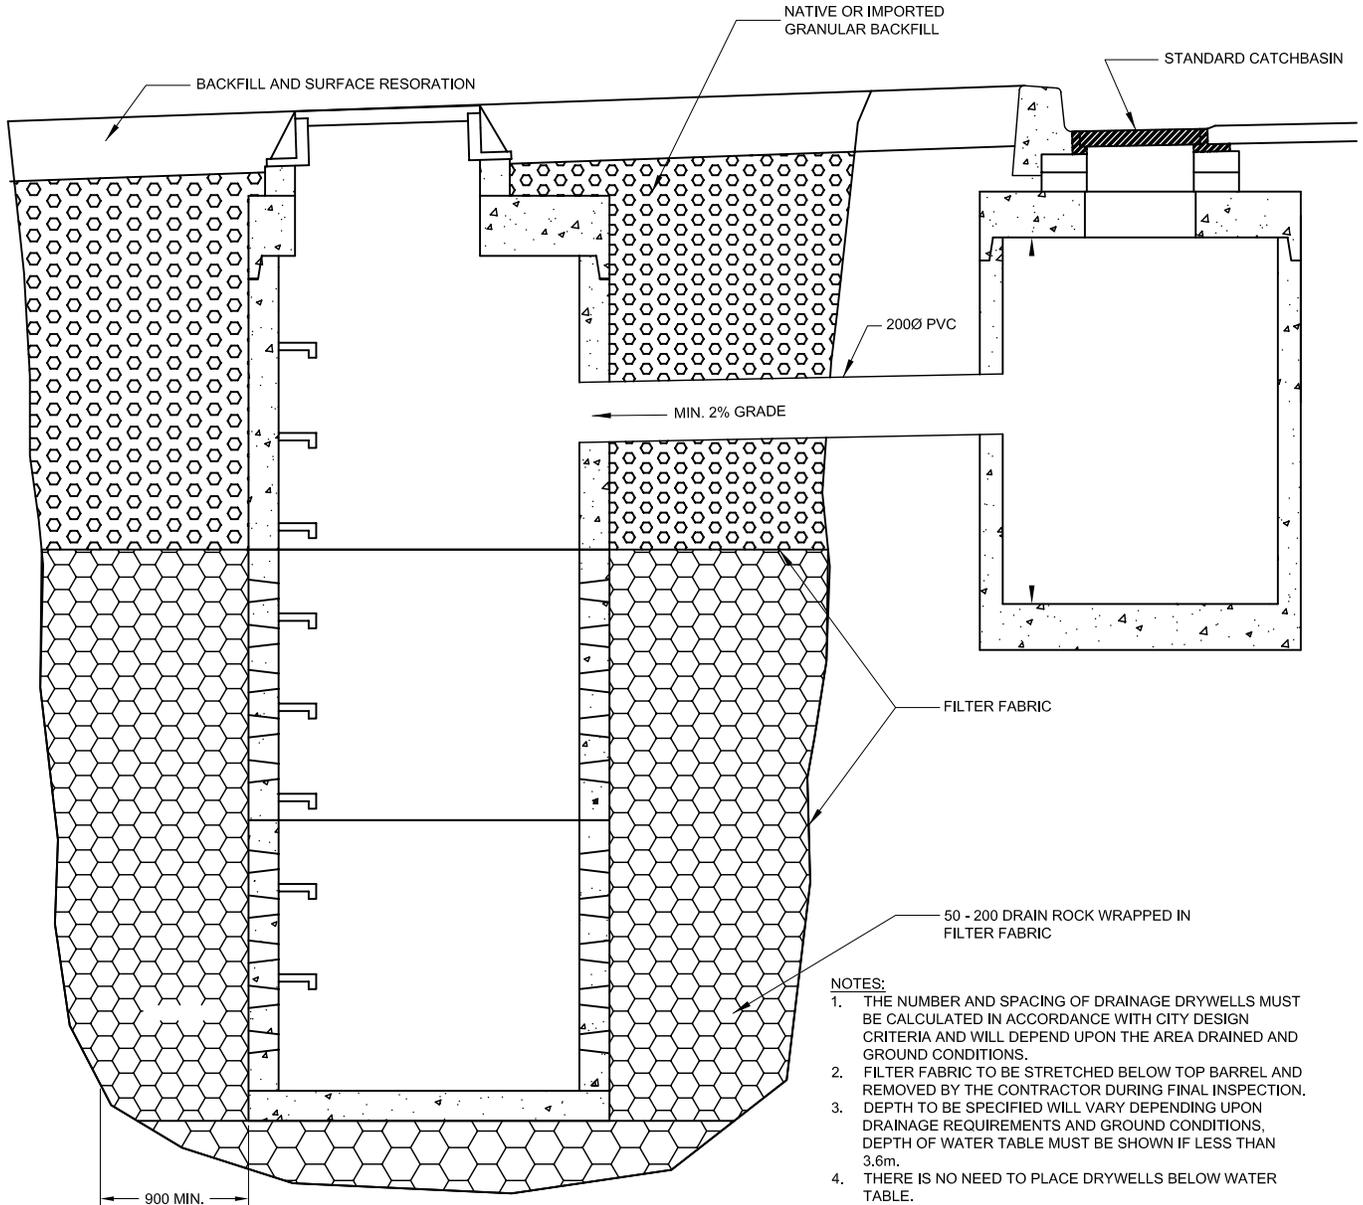

- NOTES:
1. THE NUMBER AND SPACING OF DRAINAGE DRYWELLS MUST BE CALCULATED IN ACCORDANCE WITH CITY DESIGN CRITERIA AND WILL DEPEND UPON THE AREA DRAINED AND GROUND CONDITIONS.
  2. FILTER FABRIC TO BE STRETCHED BELOW TOP BARREL AND REMOVED BY THE CONTRACTOR DURING FINAL INSPECTION.
  3. DEPTH TO BE SPECIFIED WILL VARY DEPENDING UPON DRAINAGE REQUIREMENTS AND GROUND CONDITIONS, DEPTH OF WATER TABLE MUST BE SHOWN IF LESS THAN 3.6m.
  4. THERE IS NO NEED TO PLACE DRYWELLS BELOW WATER TABLE.
  5. ALL DIMENSION IN MILLIMETRES UNLESS OTHERWISE NOTED.



City of  
Revelstoke

Title:  
DRAINAGE DRYWELL INSTALLATION